TOWN OF CASTLE ROCK BUILDING DIVISION
100 N. WILCOX ST. CASTLE ROCK, CO 80104
PHONE: (720)733-3527

THIRD PARTY WATER INSPECTIONS FOR THE TOWN OF CASTLE ROCK

Company Inspecting:	Field Engineer:	Date:
Builder/Developer:	Installed by:	
Address:	Lot:	Block:
Subdivision:	Filing No.:	Town:

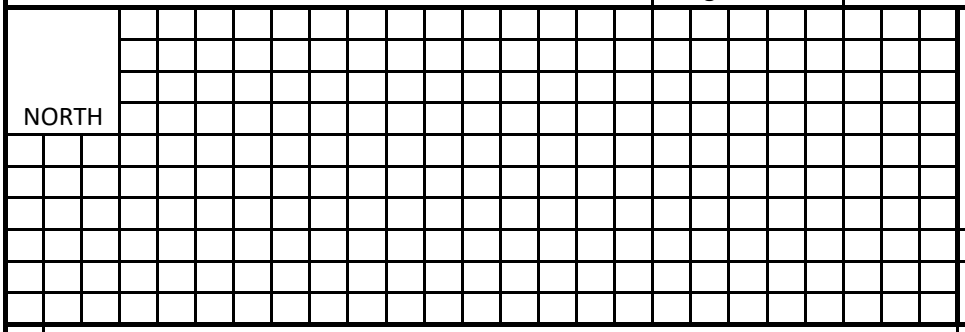

		Please Mark and Initial Below		
		Meets Code Requirements		
		YES	NO	NA
1	Provide proper sleeves, relieving arch for water line passing through or under footings and foundation. Ref 2018 IRC: P2603.4			
2	Provide correct trenching, bedding and backfill for water line. Ref 2018 IRC: P2604.1; P2604.3			
3	Provide correct support and depth (5') for water line. Ref 2018 IRC: P2605.1: Town of Castle Rock Municipal Code Ch. 15			
4	Water service supply test to be performed at service working pressure ***OR*** 50# PSI air test. Ref 2018 IRC: P2503.7			
5	Minimal water line service supply line size to be 3/4". Ref 2018 IRC: P2903.7. Service length exceeding 100' will require written variance from Town of Castle Rock.			
6	Curb stop at finish grade and located per Town of Castle Rock Public Works Department regulations.			

Comments:

Inspector: _____ Date: _____

Town of Castle Rock, it's Building Official, Inspectors, Employees and agenst area not liabel for any damage ocurring to persons or property as a result of any act or by reason of an act of ommission in the discharg of official duties. The permit holder and property owner are responsible for compliance with all applicable Town codes and regulations.